



IES INDOOR REPORT

PHOTOMETRIC FILENAME : 6CR-TL-L22-8TW-XXX-DIM-UNV-OW-CS-XX_4000K.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] GEN from BALLABS TEST NO. 20685.0

[TESTLAB] BUILDING ACOUSTICS & LIGHTING LABORATORIES, INC

[ISSUEDATE] 28-JAN-2021

[MANUFAC] WILLIAMS INDOOR

[OTHER] H.E. WILLIAMS, INC - CARTHAGE, MO

[LUMINAIRE] 1 BRIDGELUX V13 LED 6" ROUND SURFACE CYLINDER

[MORE] OPEN SEMI-SPEC SPUN ALUMINUM REFLECTOR (WIDE)

[LUMCAT] 6CR-TL-L22-8TW-xxx-DIM-UNV-OW-CS-xx_4000k

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	2289
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	95
Total Luminaire Watts	24
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.22
Spacing Criterion (90-270)	1.22
Spacing Criterion (Diagonal)	0.94
Basic Luminous Shape	Circular
Luminous Length (0-180)	0.37 ft (Diameter)
Luminous Width (90-270)	0.37 ft (Diameter)
Luminous Height	0.00 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	6941	6941	6941
55	2139	2139	2139
65	264	264	264
75	0	0	0
85	0	0	0

IES INDOOR REPORT**PHOTOMETRIC FILENAME : 6CR-TL-L22-8TW-XXX-DIM-UNV-OW-CS-XX_4000K.IES****CANDELA TABULATION**

	<u>0</u>
0	1964.480
5	2023.089
10	2083.868
15	2127.282
20	2221.707
25	2421.411
30	1897.188
35	333.202
40	86.828
45	47.755
50	24.963
55	11.939
60	5.427
65	1.085
70	1.085
75	0.000
80	0.000
85	0.000
90	0.000

IES INDOOR REPORT**PHOTOMETRIC FILENAME : 6CR-TL-L22-8TW-XXX-DIM-UNV-OW-CS-XX_4000K.IES****ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fixt
0-20	802.81	N.A.	35.10
0-30	1836.31	N.A.	80.20
0-40	2234.83	N.A.	97.60
0-60	2286.48	N.A.	99.90
0-80	2288.9	N.A.	100.00
0-90	2288.9	N.A.	100.00
10-90	2094.31	N.A.	91.50
20-40	1432.02	N.A.	62.60
20-50	1471.63	N.A.	64.30
40-70	53.78	N.A.	2.30
60-80	2.42	N.A.	0.10
70-80	0.28	N.A.	0.00
80-90	0.00	N.A.	0.00
90-110	0.00	N.A.	0.00
90-120	0.00	N.A.	0.00
90-130	0.00	N.A.	0.00
90-150	0.00	N.A.	0.00
90-180	0.00	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	2288.9	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	194.59
10-20	608.22
20-30	1033.5
30-40	398.52
40-50	39.61
50-60	12.04
60-70	2.13
70-80	0.28
80-90	0.00
90-100	0.00
100-110	0.00
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

IES INDOOR REPORT

PHOTOMETRIC FILENAME : 6CR-TL-L22-8TW-XXX-DIM-UNV-OW-CS-XX_4000K.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	111	109	106	111	109	107	105	105	103	102	101	100	98	98	97	96	94
2	108	104	100	96	106	102	98	95	99	96	93	96	93	91	93	91	89	88
3	103	97	92	88	101	95	91	87	93	89	86	90	87	85	88	86	83	82
4	98	91	85	81	96	90	85	81	87	83	80	85	82	79	84	81	78	77
5	93	85	79	75	92	84	79	75	82	78	74	81	77	74	79	76	73	72
6	89	80	74	70	87	79	74	70	78	73	69	76	72	69	75	71	68	67
7	84	75	69	65	83	75	69	65	73	68	65	72	68	64	71	67	64	63
8	80	71	65	61	79	70	65	61	69	64	61	68	64	60	67	63	60	59
9	76	67	61	57	75	66	61	57	66	60	57	65	60	57	64	60	57	55
10	73	63	58	54	72	63	57	54	62	57	54	61	57	53	61	56	53	52

IES INDOOR REPORT

PHOTOMETRIC FILENAME : 6CR-TL-L22-8TW-XXX-DIM-UNV-OW-CS-XX_4000K.IES

UGR TABLE - CORRECTED

Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

Room Size UGR Viewed Crosswise


X=2H	Y=2H	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9
	3H	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9
	4H	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9
	6H	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9
	8H	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9
	12H	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9

UGR Viewed Endwise

4H	2H	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9
	3H	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9
	4H	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9
	6H	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9
	8H	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9
	12H	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9
8H	4H	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9
	6H	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9
	8H	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9
	12H	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9
12H	4H	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9
	6H	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9
	8H	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9

Maximum UGR = 2.9

POLAR GRAPH

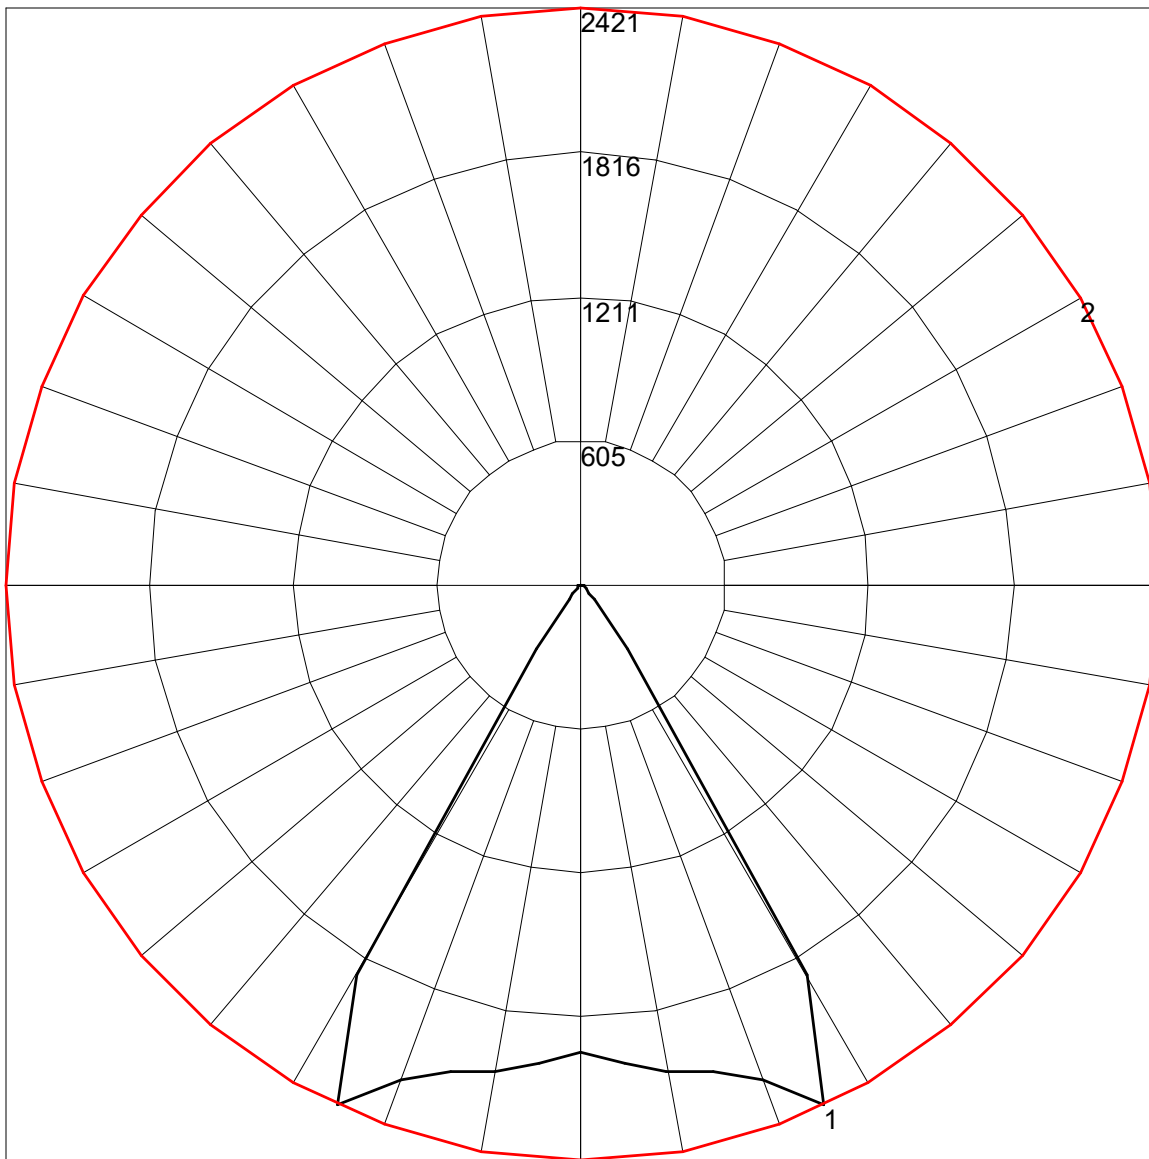

Maximum Candela = 2421.411 Located At Horizontal Angle = 0, Vertical Angle = 25
1 - Vertical Plane Through Horizontal Angles (90 - 270)
2 - Horizontal Cone Through Vertical Angle (25) (Through Max. Cd.)