



IES INDOOR REPORT

PHOTOMETRIC FILENAME : 8CR-TL-L10-835-EM10W-XXX-DIM-UNV-RW-CS-XX_EM MODE ONLY.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TEST] GEN from BALLABS TEST NO. 20733.0

[TESTLAB] BUILDING ACOUSTICS & LIGHTING LABORATORIES, INC

[ISSUEDATE] 1-FEB-2021

[MANUFAC] WILLIAMS INDOOR

[OTHER] H.E. WILLIAMS, INC - CARTHAGE, MO

[LUMINAIRE] BRIDGELUX VERO13 LED 8" ROUND SURFACE CYLINDER

[MORE] WHITE REFL w/MICRO-PRISM GLASS LENS & SEMI-SPEC CONE

[LUMCAT] 8CR-TL-L10-835-EM10W-xxx-DIM-UNV-RW-CS-xx EM MODE ONLY

[LAMPCAT] BRIDGELUX V13 BXRE-35e2000

[_SEARCH_SOURCETYPE] LED

[_SEARCH_APPLICATION] Indoor, Architectural, Classroom, Commercial, Healthcare, Office, Downlight

[_SEARCH_MOUNTING] Surface

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	820
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	82
Total Luminaire Watts	10
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	0.44
Spacing Criterion (90-270)	0.44
Spacing Criterion (Diagonal)	0.80
Basic Luminous Shape	Circular
Luminous Length (0-180)	0.48 ft (Diameter)
Luminous Width (90-270)	0.48 ft (Diameter)
Luminous Height	0.00 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	9162	9162	9162
55	6281	6281	6281
65	2425	2425	2425
75	0	0	0
85	0	0	0

IES INDOOR REPORT

PHOTOMETRIC FILENAME : 8CR-TL-L10-835-EM10W-XXX-DIM-UNV-RW-CS-XX_EM MODE ONLY.IES

CANDELA TABULATION

	<u>0</u>
0	1252.621
5	1247.531
10	757.228
15	561.559
20	555.338
25	550.814
30	451.848
35	180.400
40	127.241
45	110.841
50	89.352
55	61.641
60	37.324
65	17.531
70	5.655
75	0.000
80	0.000
85	0.000
90	0.000

IES INDOOR REPORT**PHOTOMETRIC FILENAME : 8CR-TL-L10-835-EM10W-XXX-DIM-UNV-RW-CS-XX_EM MODE ONLY.IES****ZONAL LUMEN SUMMARY**

Zone	Lumens	%Lamp	%Fxt
0-20	271.88	N.A.	33.20
0-30	514.79	N.A.	62.80
0-40	659.22	N.A.	80.40
0-60	799.46	N.A.	97.50
0-80	820.14	N.A.	100.00
0-90	820.14	N.A.	100.00
10-90	718.54	N.A.	87.60
20-40	387.33	N.A.	47.20
20-50	471.87	N.A.	57.50
40-70	159.45	N.A.	19.40
60-80	20.68	N.A.	2.50
70-80	1.48	N.A.	0.20
80-90	0.00	N.A.	0.00
90-110	0.00	N.A.	0.00
90-120	0.00	N.A.	0.00
90-130	0.00	N.A.	0.00
90-150	0.00	N.A.	0.00
90-180	0.00	N.A.	0.00
110-180	0.00	N.A.	0.00
0-180	820.14	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	101.61
10-20	170.28
20-30	242.90
30-40	144.43
40-50	84.53
50-60	55.71
60-70	19.21
70-80	1.48
80-90	0.00
90-100	0.00
100-110	0.00
110-120	0.00
120-130	0.00
130-140	0.00
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

IES INDOOR REPORT

PHOTOMETRIC FILENAME : 8CR-TL-L10-835-EM10W-XXX-DIM-UNV-RW-CS-XX_EM MODE ONLY.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC RW	80				70				50			30			10			0
	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	113	110	107	105	110	108	105	103	104	102	100	100	98	97	96	95	94	92
2	107	101	97	93	104	99	95	92	96	93	90	93	90	88	90	88	86	84
3	100	93	88	84	98	92	87	83	89	85	81	87	83	80	85	82	79	77
4	95	86	80	76	93	85	80	75	83	78	74	81	77	73	79	76	73	71
5	89	80	74	69	88	79	73	69	77	72	68	76	71	68	74	70	67	65
6	85	75	68	64	83	74	68	63	73	67	63	71	66	63	70	65	62	61
7	80	70	64	59	79	69	63	59	68	63	58	67	62	58	66	61	58	56
8	76	66	59	55	75	65	59	55	64	58	55	63	58	54	62	57	54	53
9	72	62	56	51	71	61	55	51	60	55	51	59	54	51	59	54	51	49
10	69	58	52	48	68	58	52	48	57	52	48	56	51	48	56	51	48	46

IES INDOOR REPORT

PHOTOMETRIC FILENAME : 8CR-TL-L10-835-EM10W-XXX-DIM-UNV-RW-CS-XX_EM MODE ONLY.IES

UGR TABLE - CORRECTED

Reflectances

Ceiling Cavity	70	70	50	50	30	70	70	50	50	30
Walls	50	30	50	30	30	50	30	50	30	30
Floor Cavity	20	20	20	20	20	20	20	20	20	20

Room Size UGR Viewed Crosswise

X=2H	Y=2H	14.2	15.4	14.6	15.7	16.0	14.2	15.4	14.6	15.7	16.0
	3H	14.3	15.3	14.6	15.6	16.0	14.3	15.3	14.6	15.6	16.0
	4H	14.2	15.1	14.6	15.5	15.8	14.2	15.1	14.6	15.5	15.8
	6H	14.1	14.9	14.5	15.3	15.7	14.1	14.9	14.5	15.3	15.7
	8H	14.0	14.8	14.5	15.2	15.6	14.0	14.8	14.5	15.2	15.6
	12H	14.0	14.7	14.4	15.1	15.6	14.0	14.7	14.4	15.1	15.6

UGR Viewed Endwise

4H	2H	14.2	15.1	14.6	15.5	15.9	14.2	15.1	14.6	15.5	15.9
	3H	14.2	15.0	14.7	15.4	15.8	14.2	15.0	14.7	15.4	15.8
	4H	14.1	14.8	14.6	15.2	15.7	14.1	14.8	14.6	15.2	15.7
	6H	14.0	14.6	14.5	15.1	15.5	14.0	14.6	14.5	15.1	15.5
	8H	14.0	14.5	14.4	15.0	15.4	14.0	14.5	14.4	15.0	15.4
	12H	13.9	14.4	14.4	14.9	15.3	13.9	14.4	14.4	14.9	15.3

8H	4H	14.0	14.5	14.4	15.0	15.4	14.0	14.5	14.4	15.0	15.4
	6H	13.9	14.3	14.4	14.8	15.3	13.9	14.3	14.4	14.8	15.3
	8H	13.8	14.2	14.3	14.7	15.2	13.8	14.2	14.3	14.7	15.2
	12H	13.8	14.1	14.3	14.6	15.2	13.8	14.1	14.3	14.6	15.2


12H	4H	13.9	14.4	14.4	14.9	15.4	13.9	14.4	14.4	14.9	15.4
	6H	13.8	14.2	14.3	14.7	15.2	13.8	14.2	14.3	14.7	15.2
	8H	13.8	14.1	14.3	14.6	15.2	13.8	14.1	14.3	14.6	15.2

Maximum UGR = 16.0

IES INDOOR REPORT

PHOTOMETRIC FILENAME : 8CR-TL-L10-835-EM10W-XXX-DIM-UNV-RW-CS-XX_EM MODE ONLY.IES

POLAR GRAPH

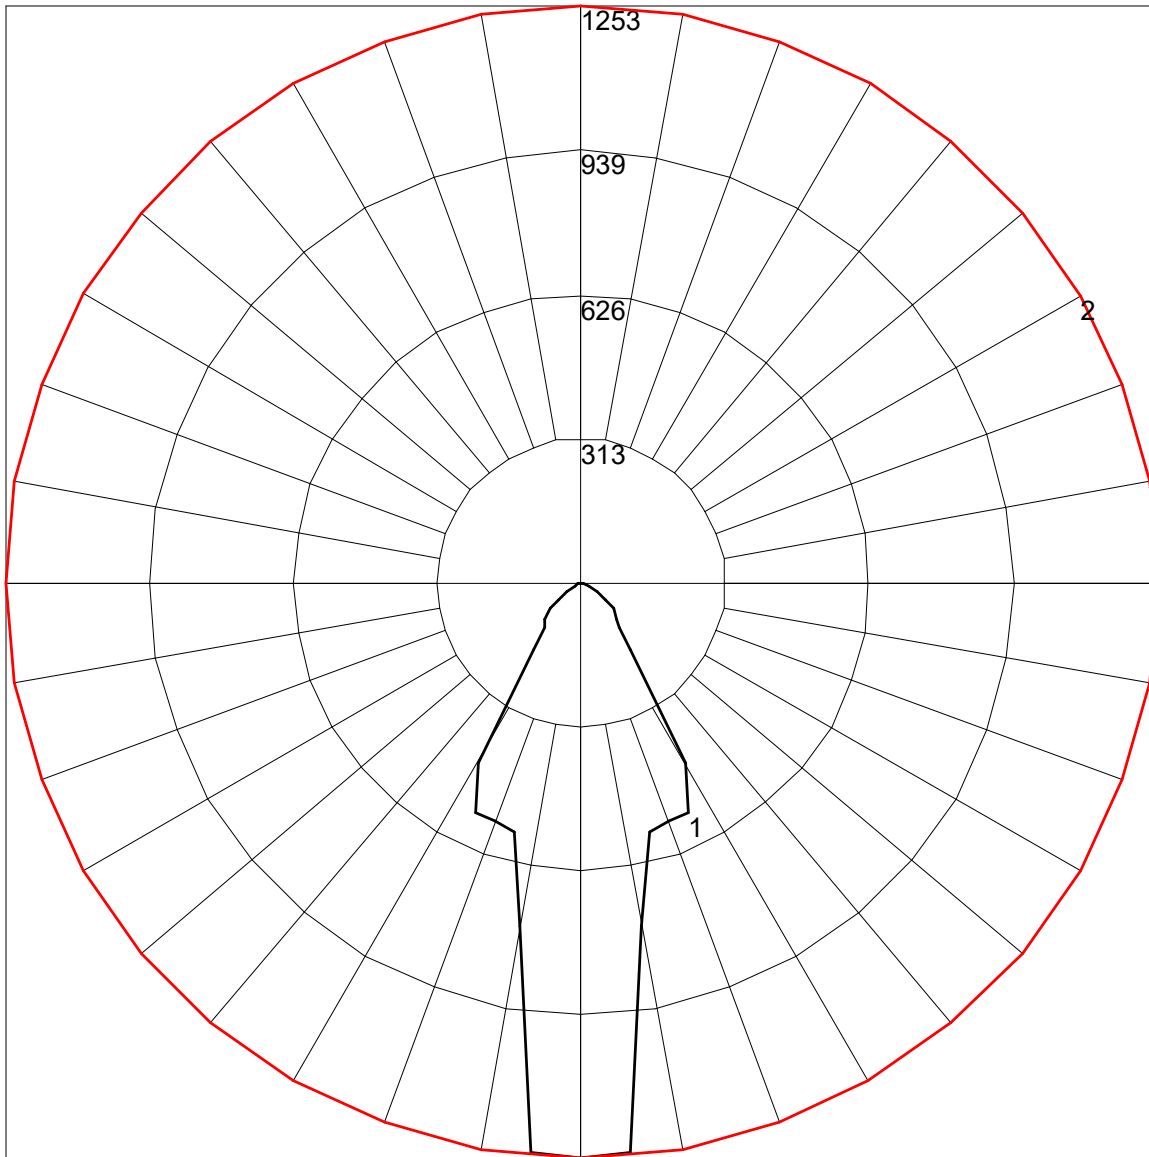

Maximum Candela = 1252.621 Located At Horizontal Angle = 0, Vertical Angle = 0

1 - Vertical Plane Through Horizontal Angles (90 - 270)

2 - Horizontal Cone Through Vertical Angle (0) (Through Max. Cd.)