

LRXS SERIES

INSTALLATION INSTRUCTIONS



WARNING:

- This product must be installed in accordance with the applicable installation code by a person familiar with the construction and operation of the product and the hazards involved.
- Make sure all electrical power is turned off while installing the fixture.
- This luminaire must be adequately grounded for protection against shock hazards and to assure proper operation.
- Disconnect power before servicing.
- LEDs are ESD (Electro Static Discharge) sensitive devices that can be easily damaged if the proper ESD mitigating steps are not taken.
- LEDs are very sensitive to mechanical damage. Caution must be taken to avoid damage to the LEDs.
- ESD or mechanical damage voids all warranties.
- Suitable for dry and damp locations.

CONTENTS


STEP 1 PLANNING.....	1	STEP 3 WIRING.....	3
STEP 1 PREPARATION.....	2	STEP 4 JOINER.....	3
STEP 2 MOUNTING POINTS	2	STEP 5 FINISHING	4

TOOLS REQUIRED



- Philips screwdriver, by others
- Tool to cut lens, by others
- ø1/4" fasteners and washers, by others
- Ceiling fasteners, by others

STEP 1 PLANNING

A. Look for linear ID label on packaging:

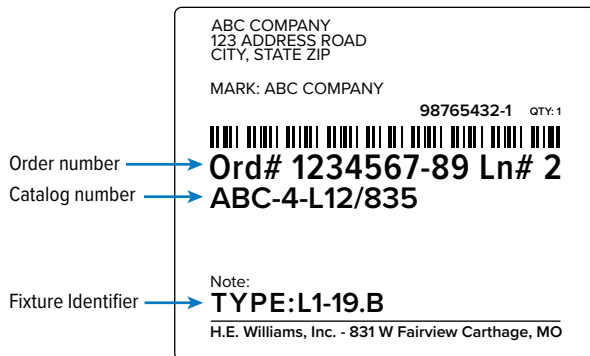


B. Identify all linear luminaires by their ID label:

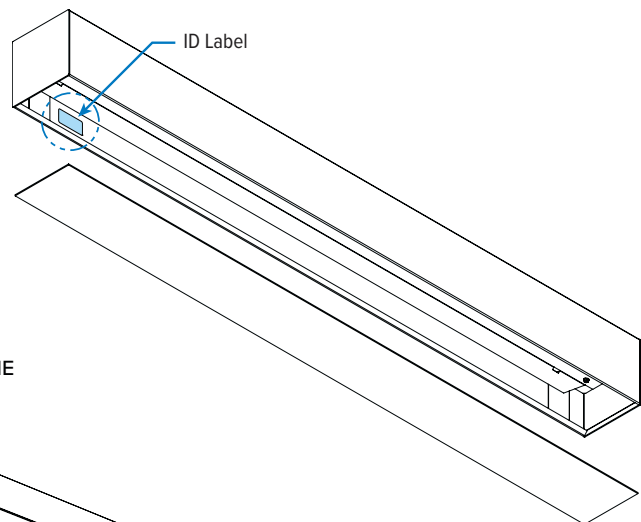


C. Sort row mount fixtures and plan mounting method.

ROW MOUNT

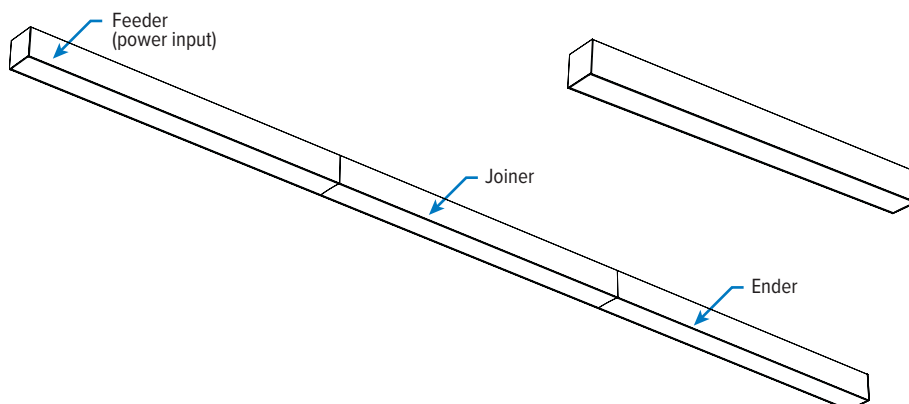

STAND-ALONE

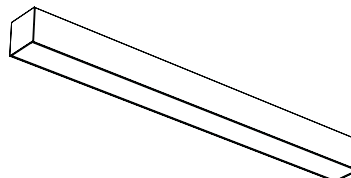


LRXS SERIES

INSTALLATION INSTRUCTIONS


STEP 1 PREPARATION

A. Remove lens and wireway cover.

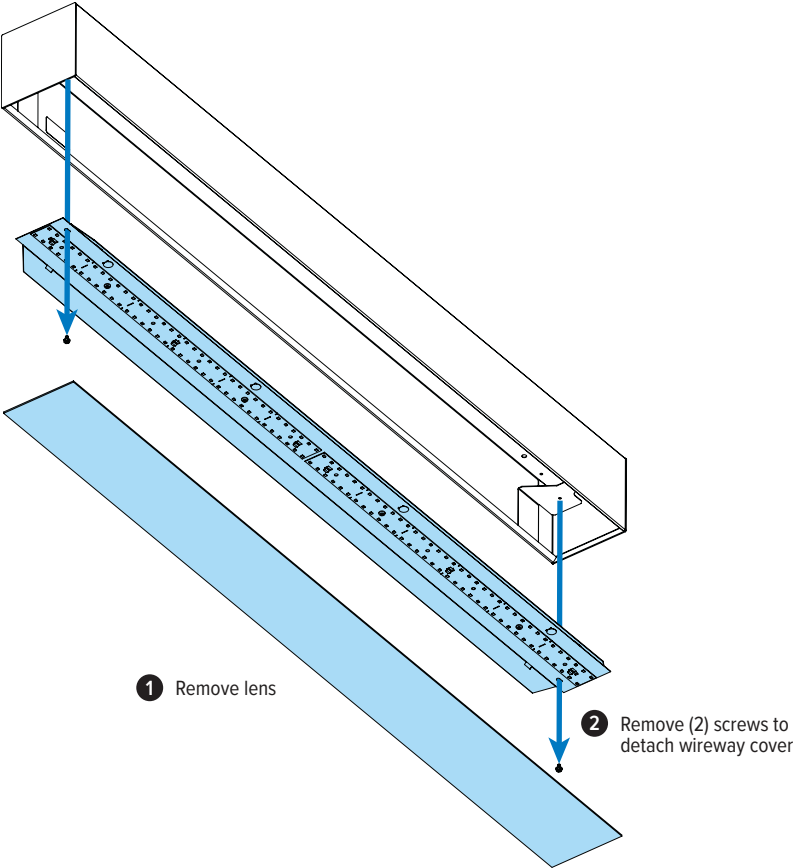

STEP 2 MOUNTING POINTS

A. Install stand-alone or feeder fixture first.

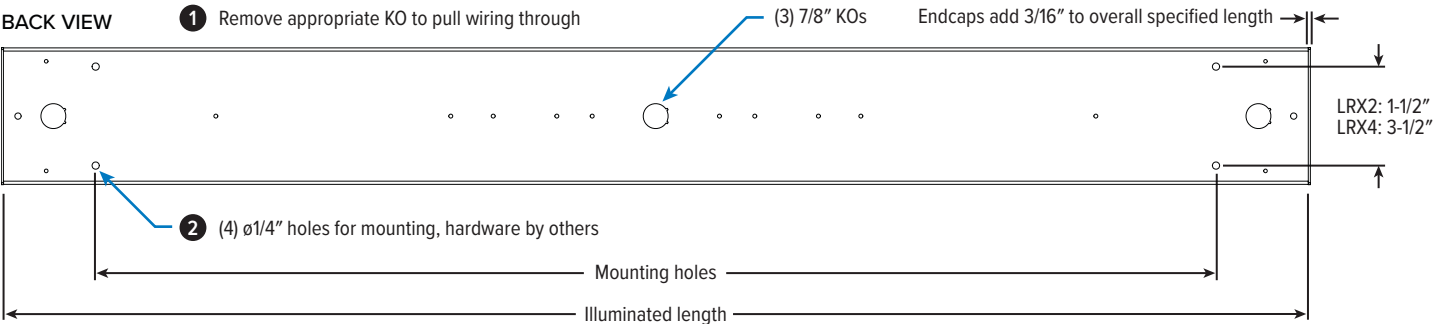



	ILLUMINATED LENGTH	MOUNTING HOLES
2'	24"	17-1/2"
4'	48"	41-1/2"
6'	72"	65-1/2"
8'	96"	89-1/2"

LRXS SERIES

INSTALLATION INSTRUCTIONS

STEP 3 WIRING


A. Make electrical connections in accordance with NEC and local codes.

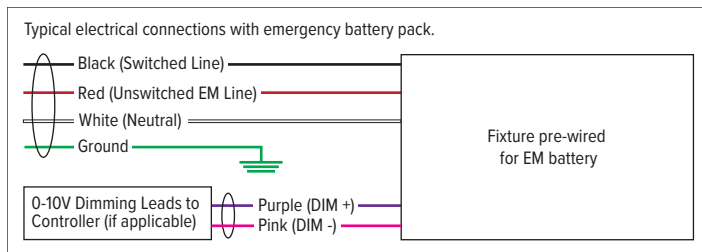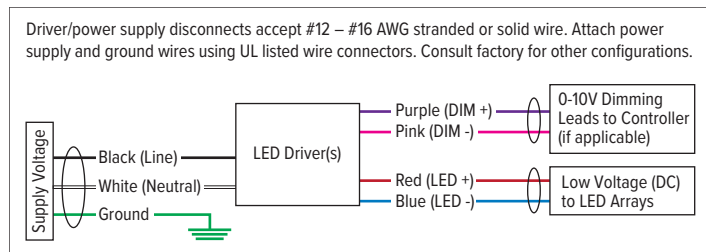

STEP 4 JOINER

STAND-ALONE INSTALLATION: PROCEED TO STEP 5 FINISHING on page 4.

A. Row mount only: attach joiner fixture to row.

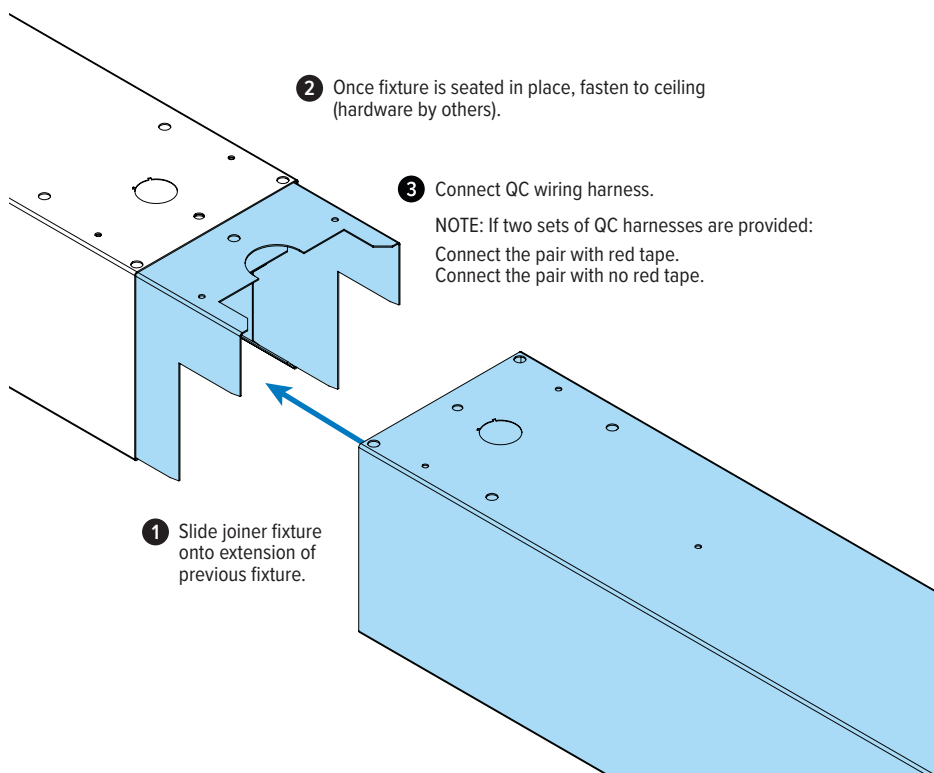


LRXS SERIES


INSTALLATION INSTRUCTIONS

STEP 5 FINISHING

A. Reinstall wireway cover.

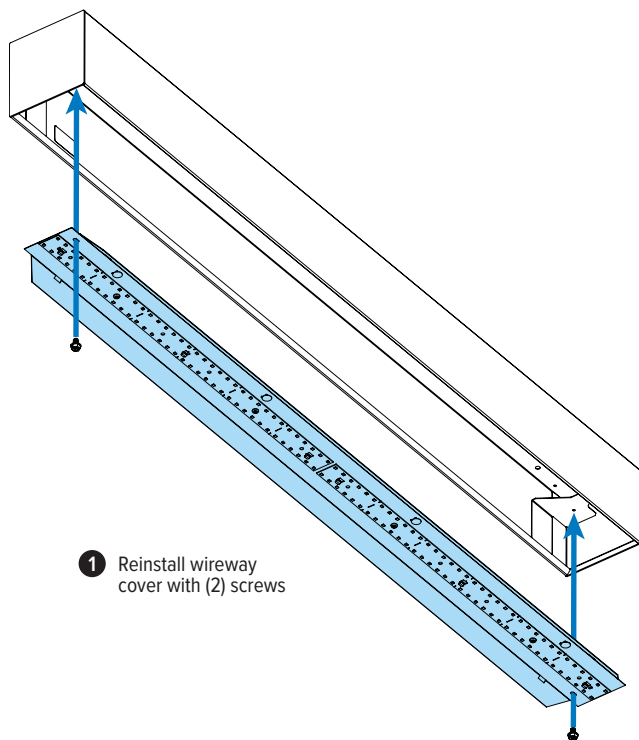

B. Row mount only: place LED shields.

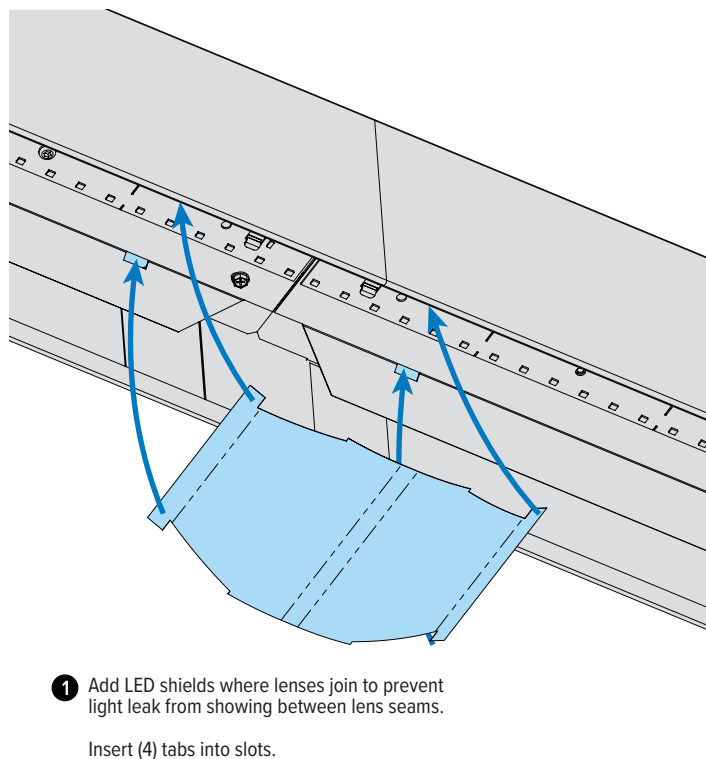

C. Reinstall lens.

